


ALL BACKFILL MATERIAL SHALL BE COMPACTED TO > 95% OF IT'S MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D698.

ASPHALT PAVEMENT

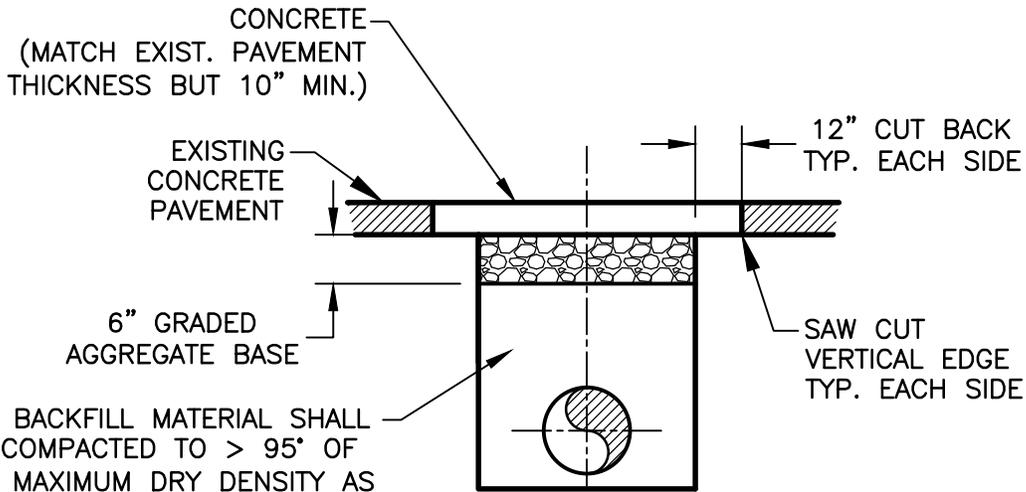

ALL BACKFILL MATERIAL SHALL BE COMPACTED TO > 95% OF IT'S MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D698.

CONCRETE PAVEMENT

NOTE:

TYPE III PAVEMENT REPLACEMENT SHALL BE USED ONLY FOR LONGITUDINAL INSTALLATION AND WHERE THE TRENCH WIDTH AT THE TOP OF PIPE IS GREATER THAN FOUR FEET.

THIS DETAIL WAS TAKEN FROM THE CITY OF ATLANTA'S WEBSITE. IT MAY HAVE BEEN MODIFIED AND SHOULD BE REVIEWED THOROUGHLY.

City of Atlanta



STANDARD DETAILS

TYPE III PAVEMENT REPLACEMENT

REV.

DATE: OCT. 2011

ORIG. DATE: OCT. 2004

SCALE: N.T.S.

DETAIL NO. WR-G_PV003