


IN PLACE OF STRAPS PROVIDE IDENTICAL TOP AND BOTTOM ASSEMBLY AS SHOWN

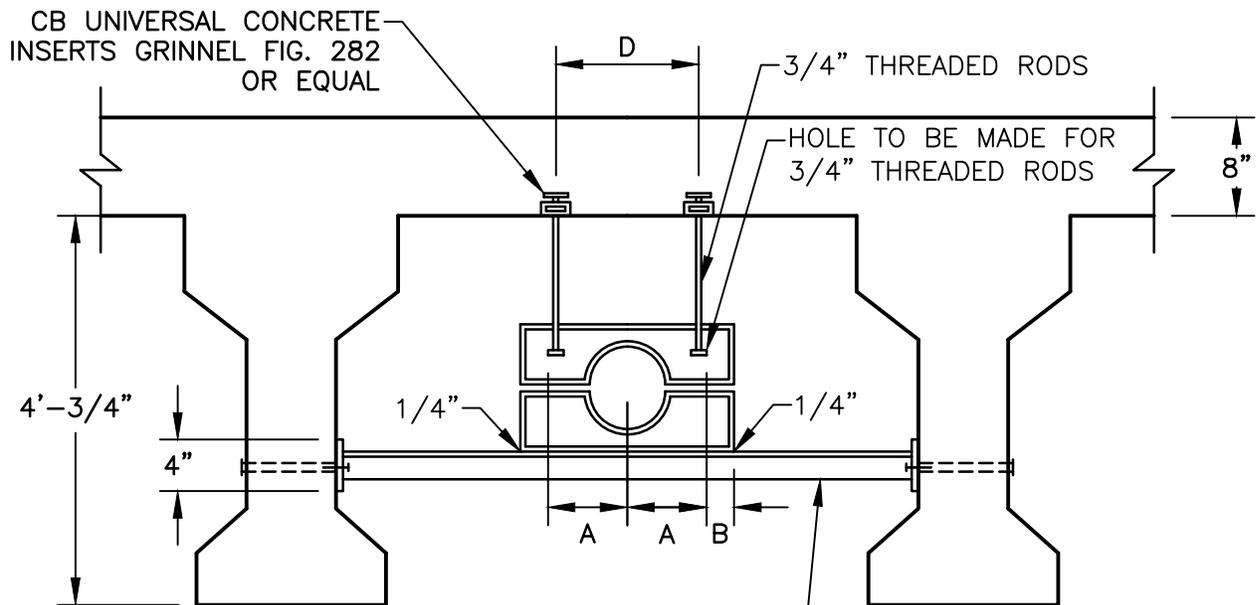

DIMENSIONS IN INCHES FOR PIPE HANGERS				
PIPE SIZE	A	B	C	D
8"	6.53	2.00	4.53	VARIES
12"	8.60	2.00	6.60	VARIES
16"	10.70	2.00	8.70	VARIES

2 NOS. OF 05x6.7 BACK TO BACK TO BE USED IF 3/4" OF THREADED RODS ARE NOT USED  
L 2 1/2"x2 1/2"x 1/4" ATTACH TO BOTH BEAMS W/RED HEADS @ TIME OF INSTALLATION OF WATER MAIN.

**NOTES:**

1. PRIMER SHALL BE NO. 1-B ORANGE PRIMER AND CONFORM TO GEORGIA D.O.T. ARTICLE B 70.02 PRIMER SHALL BE APPLIED TO A MINIMUM THICKNESS OF 4 MILS.
2. PAINT SHALL BE NO.3-A GREEN, BRUSHING, ROLLE AIRLESS TYPE AND CONFORM TO GEORGIA D.O.T. ARTICLE 870.02 PAINT SHALL BE APPLIED TO A MINIMUM THICKNESS OF 10 MILS.
3. TWO BOTTOM ASSEMBLIES USED TOGETHER MAYBE REQUIRED IN SOME INSTALLATIONS.
4. PROVIDE TWO SUPPORTS PER JOINT, TWO FEET FROM JOINT.
5. DESIGN SUPPORTS DETAILS FOR WATER MAIN LARGER THAN 16 INCH.
6. STEEL SHALL BE A-36.
7. WELDING BE E-70xx.

THIS DETAIL WAS TAKEN FROM THE CITY OF ATLANTA'S WEBSITE. IT MAY HAVE BEEN MODIFIED AND SHOULD BE REVIEWED THOROUGHLY.

City of Atlanta



**STANDARD DETAILS**

**TYPICAL HANGER DETAIL  
FOR CONCRETE  
BEAM BRIDGES**

REV.

DATE: OCT. 2011

ORIG. DATE: NOV. 2004

SCALE: N.T.S.

DETAIL NO. WR-G\_AN006